NOTES:

1. Main disconnect panel may not be used as an electrical race way.
2. Weatherproof fittings required.
3. Two (2) disconnects can be substituted with (1) fused disconnect.
4. Notify Coleman County Electric Cooperative when meter assembly is complete.
5. Wire sized to total disconnect(s) size.
6. Member will provide wire from meter assembly to transformer.
7. Neutral(s) may only be reduced one size on residential application. No reduction of the neutral(s) is allowed on commercial application.
8. Member will provide ditch and cover ditch from rack to pole.
9. Member will provide rigid aluminum conduit from pole to rack. Sweeps shall be a minimum 24" 90°. Pole height to be determined.

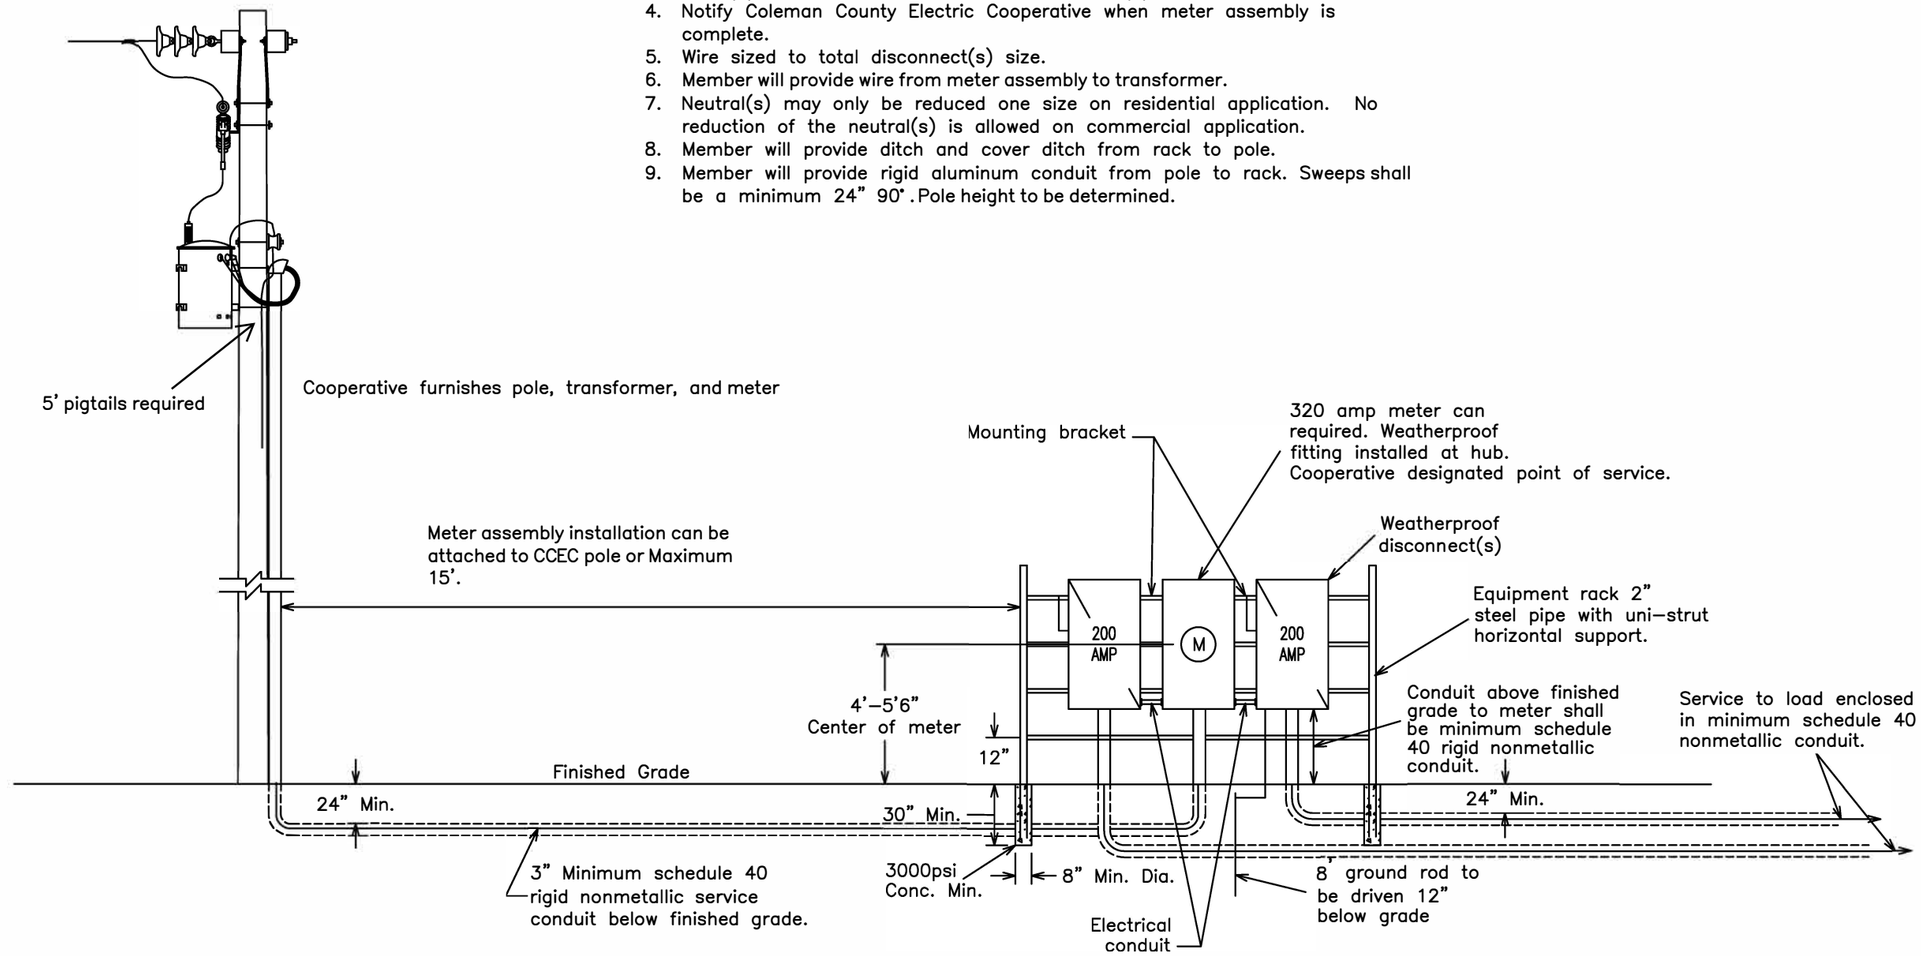

FOR THE MEMBER'S SAFETY, WIRING INSTALLATIONS SHALL CONFORM TO THE REQUIREMENTS OF THE NEC AND NESC.

COLEMAN COUNTY ELECTRIC CO-OP

320 AMP URD SERVICE ON RACK FROM OVERHEAD WITH CLASS 320 METER SOCKET, 1 OR 2 DISCONNECTS

Drawn By:		Approved By:	Revised
JH			JH
Scale:	Date:	Drawing #:	Date:
N.T.S.	09-10-21		04/19/23