


METER LOOP INSTALLATION GUIDE

COLEMAN COUNTY ELECTRIC COOPERATIVE, INC
 3300 U.S. HIGHWAY N. 84
 P.O. BOX 860
 COLEMAN, TX 76834
 (325) 625-2128

METER POLE 100 AMP SERVICE, 120/240 VAC. POLE FURNISHED BY COOPERATIVE

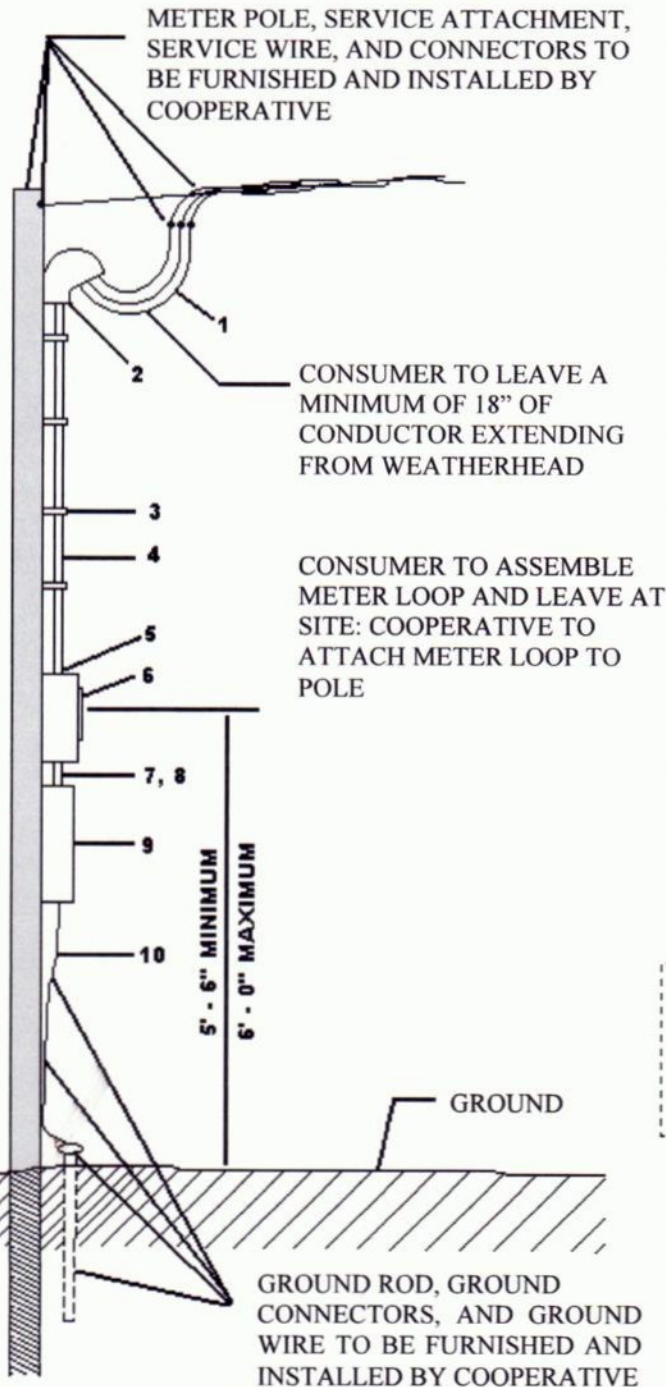

BILL OF MATERIAL

ITEM	QTY	DESCRIPTION
1	60'	#2 STRANDED COPPER CABLE WITH 90°C INSULATION RATING, TYPE RHH, THHN, THHW, OR XHHW
2	1	1 1/2" WEATHERHEAD
3	4	1 1/2" CONDUIT STRAP WITH SCREWS OR NAILS
4	15'	1 1/2" RIGID METAL CONDUIT
5	1	2" - 1 1/2" REDUCER
6	1	METER SOCKET WITH 2" HUB (FURNISHED BY COOPERATIVE AT NO CHARGE)
7	1	1 1/2" OFFSET NIPPLE - GALVANIZED
8	2	1 1/2" CONDUIT LOCKNUT
9	1	2-POLE 100 AMP WEATHERPROOF FUSED DISCONNECT SWITCH WITH 1 1/2" HUB, OR 100 AMP WEATHERPROOF LOAD CENTER WITH 100 AMP CIRCUIT BREAKER WITH 1 1/2" HUB,
10	2'	#6 SOLID SOFT DRAWN COPPER WIRE

NOTE: ALL REQUIREMENTS OF THE CURRENT EDITION OF THE NEC OR OF THE LOCAL CODES SHOULD BE FOLLOWED WHEN NOT ADDRESSED IN THIS GUIDE.